

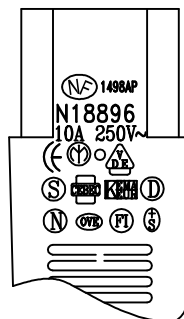


ROHS COMPLIANT


PLUG MARKING:

A/0


DATE	REV	DESCRIPTION	BY	CHECK
	A/0			




YE/GN(line)




BLUE BROWN

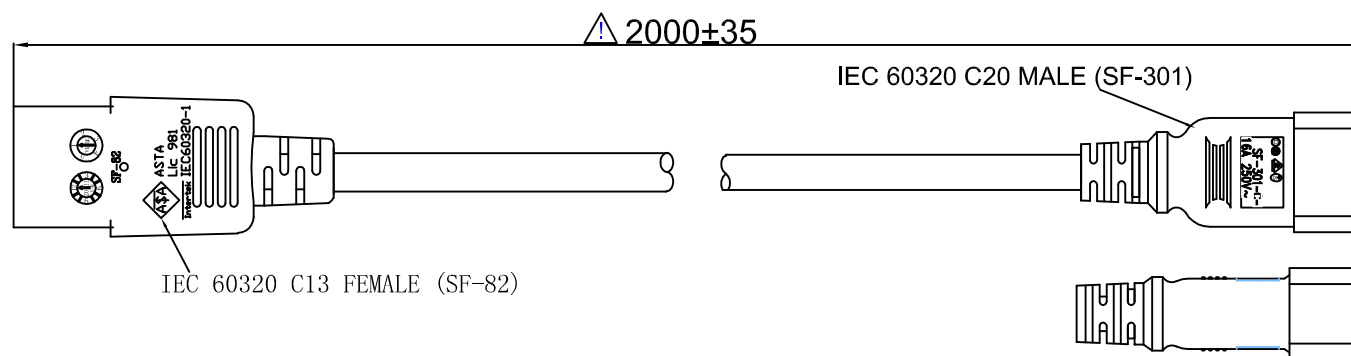

YE/GN(line)



BROWN BLUE

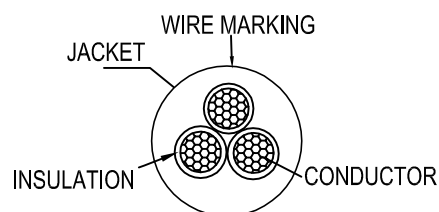

WIRE MARKING: (HOLLOW)		+ 0 + 0 + 0 KEMA-KEUR     Δ CEBEC 972  NF-USE 1345 IEMMEQU H05VV-F 3G1.0MM ² V-75 300/500V ORDINARY DUTY N SW17436					
Conductor		Insulation			Jacket		Overall diameter
mm ²	Resistance maximum (≤)	Min.Thick	Diameter	Length of Lay	MIn.Thlck	AVG.Ghick	
1.0 (32/0.190)	at20°C, 19.5ohms/km	0.44mm	2.5±0.1mm	130 ↓ mm	0.58mm	0.8mm	7.0±0.1mm
(NOTE: IF THE CONDUCTORS O.D IS GO BEYOND THE SCOPE, THE RESISTANCE OF CONDUCTOR IS STANDARD THEN)							

ELECTRIC TESTING:

1. 100% OPEN & SHORT TESTING .
3. VOLTAGE RATING:AC ≥2000V/S
- 4.PLUG IEC 60320 C13 FEMALE (SF-82) :250V 10A
- 5.PLUG IEC 60320 C20 MALE(SF-301) RATED POWER:250V 16A
- 6.WIRE: H05VV-F 3*1.0 RATED VOLTAGE:300/500V
- 7.COLOR:BLACK

PAGE

1/1

**AC**

Unless specified on the drawing, tolerances are per the follows:

.X ± 1
.XX ± 0.2
.XX ± 0.05

3RD



DESCRIPTION	H05VV-F3G1.0 SF-82+SF-301				
CUSTOMER NAME	CUSTOMER NO.				
CUSTOMER PART NO.	AK5026	DRAW	DHY	DATE	2011/10/25
SCALE		CHECK	wuxiao	DATE	2011/10/25
UNIT	MM	APPROVAL		DATE	
PATH NAME	//D//				